


NOTES:

1. PROVIDE PROTECTION FROM ALL VEHICLE TRAFFIC, EQUIPMENT STAGING, AND FOOT TRAFFIC IN PROPOSED INFILTRATION AREAS PRIOR, DURING, AND AFTER CONSTRUCTION.
2. SITTING CRITERIA: DRYWELL SHALL NOT BE LOCATED ON A SLOPE WITH GRADIENT GREATER THEN 20% (5:1, M:V)
3. TOP OF WELL MUST BE BELOW LOWEST FINISH FLOOR.
4. IF DRYWELL IS LOCATED WITHIN MINIMUM SETBACK REQUIREMENTS, THE DRYWELL SHALL BE DESIGNED BY A LICENSED ENGINEER.
5. DIRECT OVERFLOW DISCHARGE PER BUREAU OF ENGINEERING AND BUILDING & SAFETY REQUIREMENTS.
6. SEE DRYWELL FACT SHEET FOR ADDITIONAL GUIDELINES.

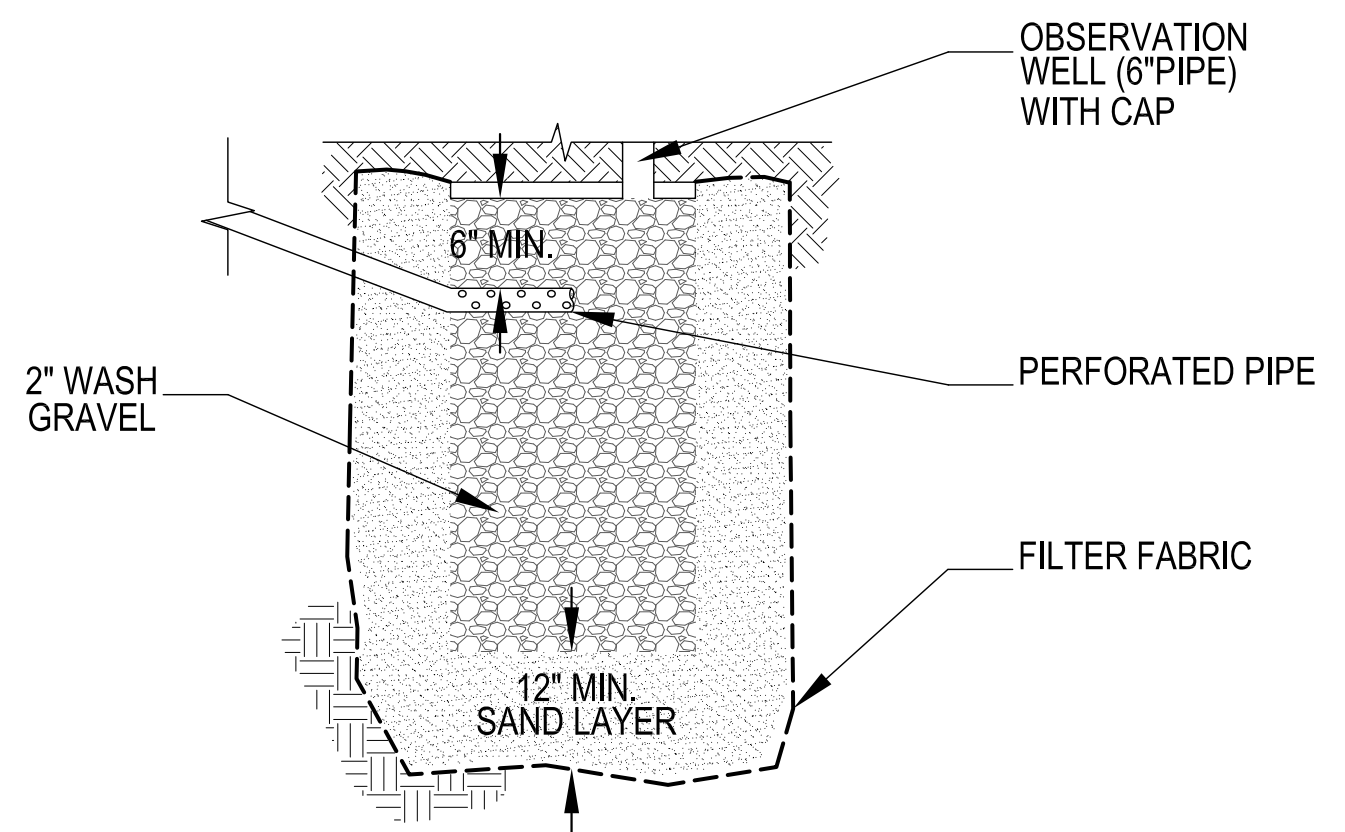

**DRYWELL
FOR SMALL SCALE RESIDENTIAL**